

Single Seal Barrier Gland for Unarmoured Cable
featuring Peppers T-1000 Compound

Class I Div 2 : AEx d : AEx e : AEx ta : IP66 : IP68 : Ex db : Ex eb : Ex nR : Ex ta



PRODUCT DESCRIPTION

“UL-X” type glands, certified Explosion Proof Class I Div 2, Gas Groups ABCD, Flameproof Ex db, Increased Safety Ex eb, Restricted Breathing Ex nR & Dust Protected Ex ta. They are suitable for use in Zone 1, Zone 2, Zone 20, Zone 21, Zone 22, Group I Mining, Gas Groups IIA, IIB, IIC and Dust Groups IIIA, IIIB, IIIC. Also certified for Zone and Division installations under CEC and NEC. Occasionally referred to as “potting glands”, they provide a compound barrier Ex db & IP seal on the cable inner cores, eliminating damage to cables that exhibit “cold flow” characteristics. The gland is suitable for use with all certified Marine Shipboard Cable and Tray Cable whilst being UL listed for Marine Shipboard Unarmoured, Jacketed or Non Jacketed cable. A unique feature includes, Peppers T-1000, the sealing compound that enables a quick and easy installation. The gland is AEx d, AEx e, AEx ta approved and rated Type 4X, maintains IP66, IP68 to 100 metres and is deluge proof without the use of an additional seal or deluge boot.

COMPLIANCE STANDARDS:

UL514B, UL1203, UL2225, UL50E, ANSI/UL 60079-0/1/7, ISA 60079-31
C22.2 No. 0/25/30/94.1/94.2/174 & CAN/CSA C22.2 60079-0/1/7/31
EN 60079-0, EN 60079-1, EN 60079-7, EN 60079-15, EN 60079-31
IEC 60079-0, IEC 60079-1, 60079-7, IEC 60079-15, IEC 60079-31 & IEC 60529

CERTIFICATION:

UL CEC - Canada NEC - USA UKEX ATEX IECEX EAC INMETRO - Brazil CCC - China UKRAINE CCoE - India ECAS-Ex - U.A.E ABS LLOYD'S DNV	UL	Class I Division 2, Gas Groups A, B, C & D, Type 4X
	CEC - Canada	Class I Division 2, Groups A, B, C & D Class II Division 1, Groups E, F & G Class I Zone 1 Ex d IIC Gb / Ex e IIC Gb Class II Zone 21 Ex ta IIIC Da Class III, Type 4X
	NEC - USA	Class I Division 2, Groups A, B, C & D Class II Division 1, Groups E, F & G Class I Zone 1 AEx d IIC Gb / AEx e IIC Gb Class II Zone 21 AEx ta IIIC Da Class III, Type 4X
	UKEX	I M2 II 1D 2G Ex db I Mb / Ex db IIC Gb / Ex eb I Mb / Ex eb IIC Gb / Ex ta IIIC Da II 3G Ex nR IIC Gc
	ATEX	I M2 II 1D 2G Ex db I Mb / Ex db IIC Gb / Ex eb I Mb / Ex eb IIC Gb / Ex ta IIIC Da II 3G Ex nR IIC Gc
	IECEX	Ex db I Mb / Ex db IIC Gb / Ex eb I Mb / Ex eb IIC Gb / Ex nR IIC Gc / Ex ta IIIC Da
	EAC	PB Ex db I Mb X / 1Ex db IIC Gb X / PB Ex eb I Mb x / 1Ex eb IIC Gb X / 2Ex nR IIC Gc X Ex ta IIIC Da X
	INMETRO - Brazil	Ex db I Mb / Ex db IIC Gb / Ex eb I Mb / Ex eb IIC Gb / Ex nR IIC Gc / Ex ta IIIC Da
	CCC - China	Ex db I Mb / Ex db IIC Gb / Ex eb I Mb / Ex eb IIC Gb / Ex nR IIC Gc / Ex ta IIIC Da
	UKRAINE	I M2 Ex db I Mb / II 2G Ex db IIC Gb / II 2G Ex eb I Mb / II 2G Ex eb IIC Gb II 3G Ex nR IIC Gc / II 1D Ex ta IIIC Da
UL CEC - Canada NEC - USA UKEX ATEX IECEX EAC INMETRO - Brazil CCC - China UKRAINE CCoE - India ECAS-Ex - U.A.E ABS LLOYD'S DNV	CCoE - India	Ex db I Mb / Ex db IIC Gb / Ex eb I Mb / Ex eb IIC Gb / Ex nR IIC Gc
	ECAS-Ex - U.A.E	Ex db I Mb / Ex db IIC Gb / Ex eb I Mb / Ex eb IIC Gb / Ex nR IIC Gc
	ABS	Specified ABS Rules
	LLOYD'S	Ex db I Mb / Ex db IIC Gb / Ex eb I Mb / Ex eb IIC Gb / Ex nR IIC Gc / Ex ta IIIC Da
	DNV	Ex db I Mb / Ex db IIC Gb / Ex eb I Mb / Ex eb IIC Gb / Ex nR IIC Gc / Ex ta IIIC Da
	UL	E248936
	CEC - Canada	CSA 70004604
	NEC - USA	CSA 70004604
	UKEX	CML 21UKEX1028X & CML 21UKEX4037X
	ATEX	CML 19ATEX1349X & CML 19ATEX4114X
UL CEC - Canada NEC - USA UKEX ATEX IECEX EAC INMETRO - Brazil CCC - China UKRAINE CCoE - India ECAS-Ex - U.A.E ABS LLOYD'S DNV	IECEX	IECEX CML 19.0107X
	EAC	RU C-GB.AX58.B.05106/24
	INMETRO - Brazil	NCC 13.1957 X
	CCC - China	2021312313000425
	UKRAINE	CLJ 18.0324 X
	CCoE - India	PESO P494321/9 & P494321/20
	ECAS-Ex - U.A.E	25-06-153223/E25-06-159811/NB0007
	ABS	25-0158110-PDA
	LLOYD'S	LR25189453TA
	DNV	TAE00004XX

CERTIFICATION:

UL	E248936
CEC - Canada	CSA 70004604
NEC - USA	CSA 70004604
UKEX	CML 21UKEX1028X & CML 21UKEX4037X
ATEX	CML 19ATEX1349X & CML 19ATEX4114X
IECEX	IECEX CML 19.0107X
EAC	RU C-GB.AX58.B.05106/24
INMETRO - Brazil	NCC 13.1957 X
CCC - China	2021312313000425
UKRAINE	CLJ 18.0324 X
CCoE - India	PESO P494321/9 & P494321/20
ECAS-Ex - U.A.E	25-06-153223/E25-06-159811/NB0007
ABS	25-0158110-PDA
LLOYD'S	LR25189453TA
DNV	TAE00004XX


CABLE GLAND SELECTION TABLE
(ALL DIMENSIONS IN INCHES)

Gland Size	Entry Thread Size		Metric Thread Length [B]	NPT Thread Length [B]	Cable Acceptance Details [C]				Nominal Protrusion Length [L]	Dimensions/Weight (NPT Entry Thread Versions)			Shroud Size (Metric)
	Metric	NPT			Max No. of Cores IEC - NEC	Max Ø Over Cores	Max Outer Sheath [D]	Across Flats [A]		Across Corners	Weight (lbs)		
20S	M20 x 1.5	1/2" or 3/4"	0.630	0.783 or 0.795	35	4	0.409	0.461	41	1.000	1.102	0.138	L24*
20	M20 x 1.5	1/2" or 3/4"	0.630	0.783 or 0.795	40	8	0.492	0.551	41	1.180	1.299	0.170	L30
25	M25 x 1.5	3/4" or 1"	0.630	0.795 or 0.985	60	16	0.701	0.787	47	1.480	1.630	0.320	L38
32	M32 x 1.5	1" or 1 ¼"	0.630	0.985 or 1.008	80	30	0.925	1.035	58	1.810	1.992	0.612	L46
40	M40 x 1.5	1 ¼" or 1 ½"	0.630	1.008 or 1.024	130	60	1.134	1.268	58	2.170	2.382	0.790	L55
50	M50 x 1.5	2"	0.630	1.059	400	5	1.551	1.736	65	2.560	2.815	0.980	L65
63	M63 x 1.5	2 ½"	0.748	1.571	425	4	1.969	2.205	66	3.150	3.465	1.510	L86
75	M75 x 1.5	3"	0.748	1.634	425	4	2.394	2.677	66	3.890	4.280	1.732	L99

NOTES

- Gland size does not necessarily equate to the entry thread size.
- UL approval/applications have a reduced core quantity. Consult product installation instructions for specific core data.
- Dimensions (A) & (B) may differ for glands with non metric entry threads.
- Please refer to our "Thread Reference Tables" for specific dimensions.
- Assembly instructions must be read prior to installation and adhered to in full.
- Peppers supply products with parallel entry threads that conform to the flameproof threaded joint requirements of IEC/EN 60079-1 and other equivalent standards. We usually incorporate a thread run out according to general machining techniques and parts will not have a full form thread for the entire length. Peppers Cable Glands Limited will not be held responsible for clients' installations where this has not been taken into account.
- Metric versions are supplied with an IP O-ring.
- All brass entry threads are Nickel Plated as standard.
- When selecting IP Washer & Shroud material for use with glands, please be aware of the accessories temperature range to ensure they are suitable for the intended installation.
- The gland is supplied with the correct amount of the two-part compound, gloves and instructions to allow one complete termination.
- Where approval in addition to UL, UKEX, ATEX, IECEX and CSA is required, this must be clearly requested at time of enquiry / order.
- * For glands size 16 and 20S when used with 3/4" NPT entry thread an L30 shroud would be required.

PRODUCT TYPE UL-X

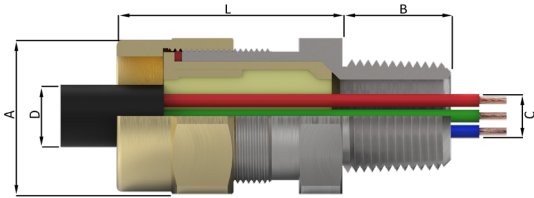

EXAMPLE PART NUMBERING:
UL-XB/NP/20/075NPT

UL-X	Gland featuring a Compound (Barrier) Inner Seal with Nickel Plated Entry Thread
B	Brass (B) / Stainless Steel (S)
C	PVC Shroud (C) - LSOH Silicone Shroud (3)
K-V-H	Locknut & Nylon (K), Fibre (V) or PTFE (H) IP Washer
T	Including Earth Tag
S	Including Serrated Washer
1	Quantity per kit
NP	Nickel Plated
20	Gland shell size
075NPT	3/4"NPT Male Entry Thread

OPTIONAL ACCESSORIES:

LOCKNUT (L)	Brass (ACBLN) / Stainless Steel (ACSLN)
EARTH TAG (T)	Brass (ACBET) / Stainless Steel (ACSET)
IP WASHERS	Nylon (N) / Fibre (J) / PTFE (Z)
SERRATED WASHERS	Stainless Steel (S)
SHROUDS	PVC (C) / LSOH Silicone (3)

IP RATING:	IP66 & IP68 (100 metres - 7 Days) Type 4X, Oil Resistant II & DTS01:1991
OPERATING TEMP:	-60°C to +135°C (-25°C to +85°C for UL applications)
MATERIALS:	Brass or Stainless Steel
PLATING:	Electroless Nickel
COMPOUND:	Peppers T-1000 Sealing Compound

CURING TIME:
@ 21°C Conductor termination can be effected after 1 hour.
The equipment can be energised after 4 hours.